

Contact person

Pavlos Ollandezos
Division Built Environment
+46 10 516 68 64
pavlos.ollandezos@ri.se

Date

2023-05-23

Reference

1195089 B

Page

1 (2)

Finja Bemix AB
Andreas Haldin
Finvids väg 6
194 04 Upplands Väsby

Testing of hydrophobic impregnation for the protection of concrete structures – Prevention of chloride ingress

(2 appendices)

1 Assignment

Testing of *Bemix Condur Fluid* hydrophobic impregnation product on concrete with respect to prevention of chloride ingress and infrared analysis. The tests were carried out in accordance with the directions of NT BUILD 515, Edition 1, *Hydrophobic impregnations for Concrete – Prevention of chloride ingress – Filter effect*.

These test results have been published in report 6P00354 B 2016-10-28 for the same product, under another product name.

2 Test schedule

The test objects and scope of the test are shown in table 1. The tests were carried out between May and October 2016.

Tabel.1. Test schedule for treated and untreated concrete samples

Property	Method	Test object	
		Measurements Dimensions (mm)	Number
Prevention of chloride ingress – filter effect	NT BUILD 515	100x100x50	3 treated
			3 untreated

The concrete and the test specimens were produced and stored at RISE in Borås in accordance with the directions of EN 1766. Tests were carried out on “Type MC(0.45)”.

Bemix Condur Fluid batch nr KH 13145, which arrived at RISE on 26 April 2016, was applied by RISE in accordance with the manufacturer’s recommendations. An amount equivalent to approximately 130 g/m² was applied to the test surface of each test specimen (applied by dipping, 3 times for 5 min each with an interval of 15 min).

The amount of impregnation product applied was checked by weighing. RISE has no other information relating to the substance and its sampling.

RISE Research Institutes of Sweden AB

Postal address
Box 857
501 15 BORÅS
SWEDEN

Office location
Brinellgatan 4
504 62 Borås
SWEDEN

Phone / Fax / E-mail
+46 10-516 50 00
+46 33-13 55 02
info@ri.se

This document may not be reproduced other than in full, except with the prior written approval of RISE Research Institutes of Sweden AB.

3 Results

The chloride profiles of the test specimens were then determined as the Cl^- level in % of the weight of the concrete in six steps down to a depth of 25 mm in accordance with EN 14629:2007 *Products and systems for the protection and repair of concrete structures – Test methods – Determination of chloride content in hardened concrete*.

The results of the determination of the chloride profile is shown in diagram 1 as the mean of results from three specimens. The measurement data is reported in Appendix 1.

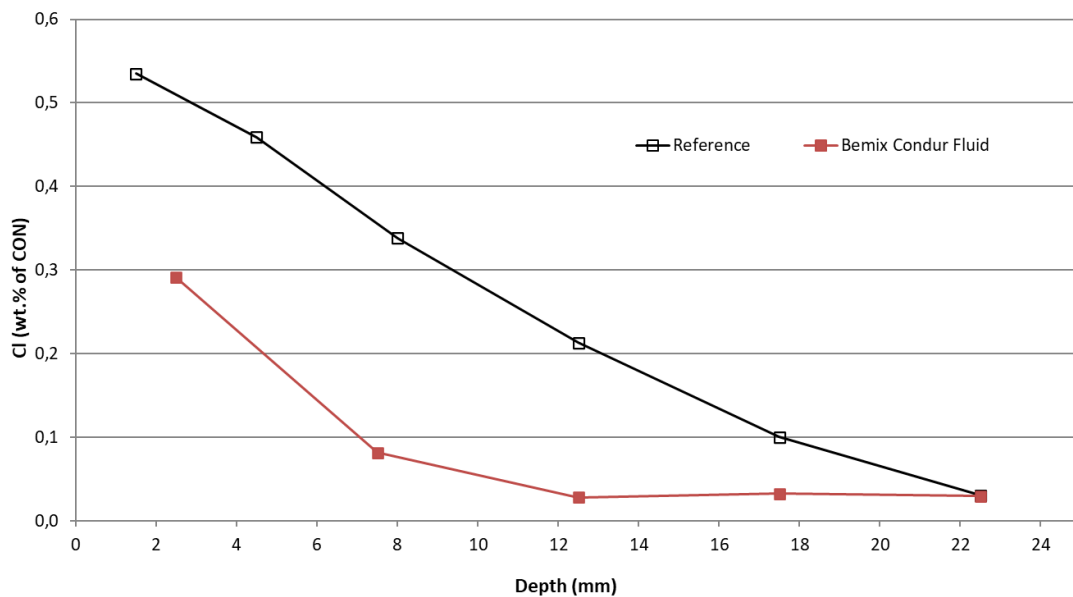


Diagram 1. Chloride content

4 Comments

The tested hydrophobic impregnation product, *Bemix Condur Fluid*, meets the requirement of AMA Anläggning 23, LFB.311. The calculated filter effect (FE_{25}) is 0.71 which is higher than the requirement on minimum value, which is 0.60.

RISE Research Institutes of Sweden AB Infrastructure and Concrete technology - Material Lab

Performed by

Pavlos Ollandezos

Appendices

1. Test schedule.
2. Test results of the determination of the chloride content.

Appendix 1

NT-Build 515			
MC(0,45) 100x100x100	Datum	Referens	Bemix Condur Fluid
Tillverkning	2016-05-23	R	KH 13145
Vattenlagring	2016-05-24		
20±2C			
Sågning, 100x100x50	2016-06-20	3	3
Vinkelrätt överytan inga håligheter ≥ Ø5 mm			
Försegling med epoxi	2016-06-20	R1	BS1
20±2C, 65±5 RF		R2	BS2
ca 2-3 h efter sågning		R3	BS3
2 st appliceringar			
Limning av gummiduk	2016-06-22		BS1
20±2C, 65±5 RF			BS2
			BS3
Applicering	2016-06-27		BS1 1111,31
20±2C, 65±5 RF	10:15		1112,23
			0,92
			BS2 1192,00
			1192,94
			0,94
<i>Bemix Condur Fluid: 3 gånger</i>			BS3 1112,73
<i>5 min i vätskan</i>			1113,49
<i>15 min i luft</i>			0,76
	10:35		BS1 1112,24
			1112,63
			0,39
			BS2 1192,96
			1193,30
			0,34
			BS3 1113,52
			1113,85
			0,33
	10:55		BS1 1112,59
			1112,66
			0,07
			BS2 1193,28
			1193,35
			0,07
			BS3 1113,82
			1113,91
			0,09
Start exp i 15% NaCl-lösning	2016-07-25	R1	BS1
20±2C		R2	BS2
Separata behållare		R3	BS3
Kontroll efter 14 resp 28 dygn			
Avslut exponering	2016-09-19	R1	BS1
Provkroppar torkas		R2	BS2
Placeras i plastpåsar		R3	BS3
Sedan i 5±2C			
Svarvning start tidigast	2016-09-19	R1	BS1
avslutas senast	2016-09-26	R2	BS2
<i>Dock inom max två dagar efter start</i>		R3	BS3
<i>Beh/obeh svarvas parallellt</i>			
Torkning	2016-09-19	R1	BS1
105±5C		R2	BS2
		R3	BS3
Förvaring av betongpulver		R1	BS1
skyddas mot CO2 och fukt		R2	BS2
fram till kloridanalys		R3	BS3

Appendix 2

			Reference								Bemix Condur Fluid								
Max depth	Middle	Thickness	REF1	REF2	REF3	Avg	Avg-bg	Std	COV (%)	CI/step	BS1	BS2	BS3	Avg	Avg-bg	Std	COV (%)	CI/step	
step [mm]	[mm]	[mm]	(fig)								(fig)								
3	1,50	3,00	0,518	0,538	0,549	0,535	0,506	0,016	3	0,061									
6	4,50	3,00	0,439	0,466	0,472	0,459	0,430	0,018	4	0,052	0,302	0,251	0,322	0,291	0,262	0,037	13	0,052	
10	8,00	4,00	0,323	0,355	0,337	0,338	0,309	0,016	5	0,049	0,070	0,095	0,081	0,082	0,052	0,012	15	0,008	
15	12,50	5,00	0,208	0,205	0,227	0,213	0,184	0,012	6	0,037	0,035	0,019	0,030	0,028	-0,001	0,008	28	0,000	
20	17,50	5,00	0,092	0,091	0,118	0,100	0,071	0,015	15	0,014	0,028	0,022	0,046	0,032	0,003	0,013	39	0,001	
25	22,50	5,00	0,020	0,033	0,039	0,031	0,001	0,010	32	0,000	0,025	0,028	0,036	0,030	0,000	0,005	18	0,000	
Total		25									0,213								0,061
Filter effect (FE₂₅)																		0,71	

Verifikat

Transaktion 09222115557493234656

Dokument

1195089B_Bemix Condur Fluid

Huvuddokument

4 sidor

Startades 2023-05-23 10:16:47 CEST (+0200) av Pavlos

Ollandezos (PO)

Färdigställt 2023-05-23 10:17:10 CEST (+0200)

Signerande parter

Pavlos Ollandezos (PO)

RISE Research Institutes of Sweden AB

Org. nr 556464-6874

pavlos.ollandezos@ri.se



Signerade 2023-05-23 10:17:10 CEST (+0200)

Detta verifikat är utfärdat av Scrive. Information i kursiv stil är säkert verifierad av Scrive. Se de dolda bilagorna för mer information/bevis om detta dokument. Använd en PDF-läsare som t ex Adobe Reader som kan visa dolda bilagor för att se bilagorna. Observera att om dokumentet skrivs ut kan inte integriteten i papperskopian bevisas enligt nedan och att en vanlig papperutskrift saknar innehållet i de dolda bilagorna. Den digitala signaturen (elektroniska förseglingen) säkerställer att integriteten av detta dokument, inklusive de dolda bilagorna, kan bevisas matematiskt och oberoende av Scrive. För er bekvämlighet tillhandahåller Scrive även en tjänst för att kontrollera dokumentets integritet automatiskt på: <https://scrive.com/verify>

